

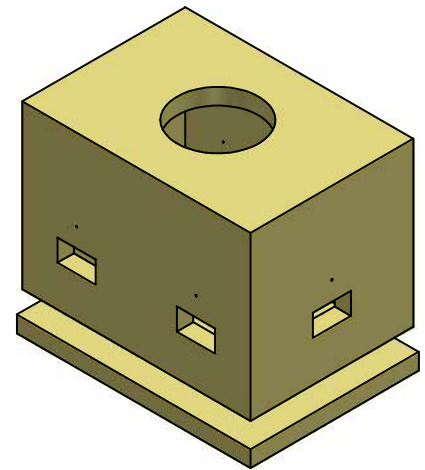
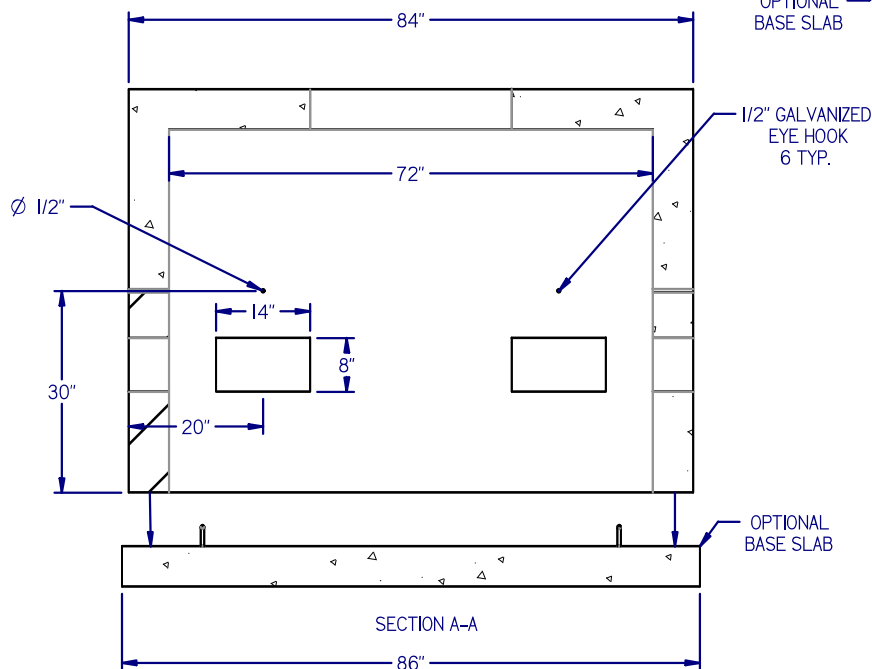


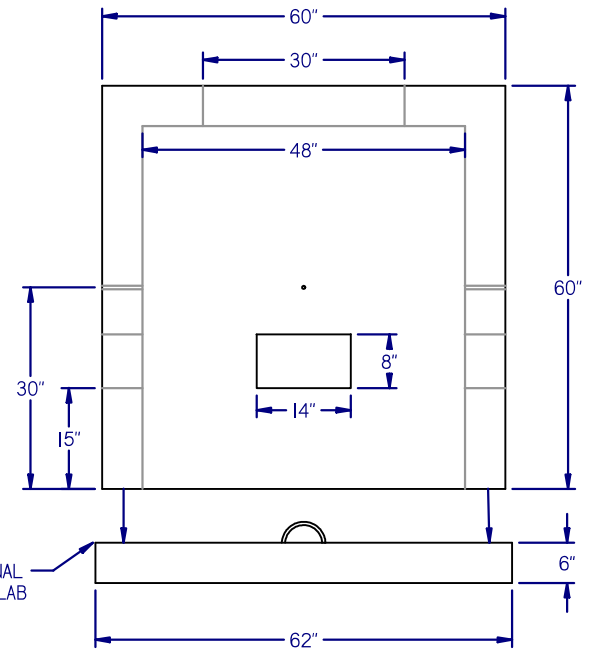

COMPONENT	WEIGHT (LBS)
PULL BOX	8200
BASE SLAB	2500

NOTES:

1. CONCRETE: 5000 PSI AFTER 28 DAYS
2. REINFORCING PER CMP SPECIFICATIONS
3. EXCAVATION MUST BE AT LEAST 12" WIDER AND LONGER THAN PAD SIZE

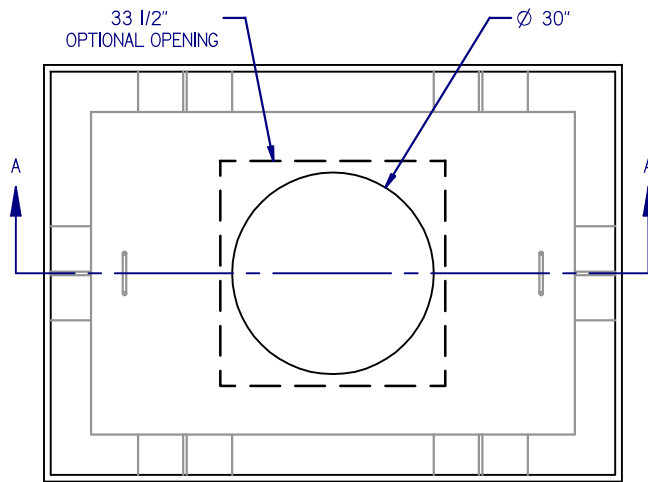

CMP 4 X 6 PULL BOX

238 Country Club Road (Route 4) Sanford, ME 04073

(207) 324-7215 (800) 477-8177

Date: 8/20/2025